


ALL TECHNICAL INFORMATION CONTAINED IN THIS DOCUMENT IS THE EXCLUSIVE PROPERTY OF SCHNEIDER ELECTRIC INDUSTRIES SAS AND MAY NEITHER BE USED NOR DISCLOSED WITHOUT ITS PRIOR WRITTEN CONSENT.


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A00	NEW RELEASE	12/08/06	I.K.
B00	REVISED	09/05/08	I.K.

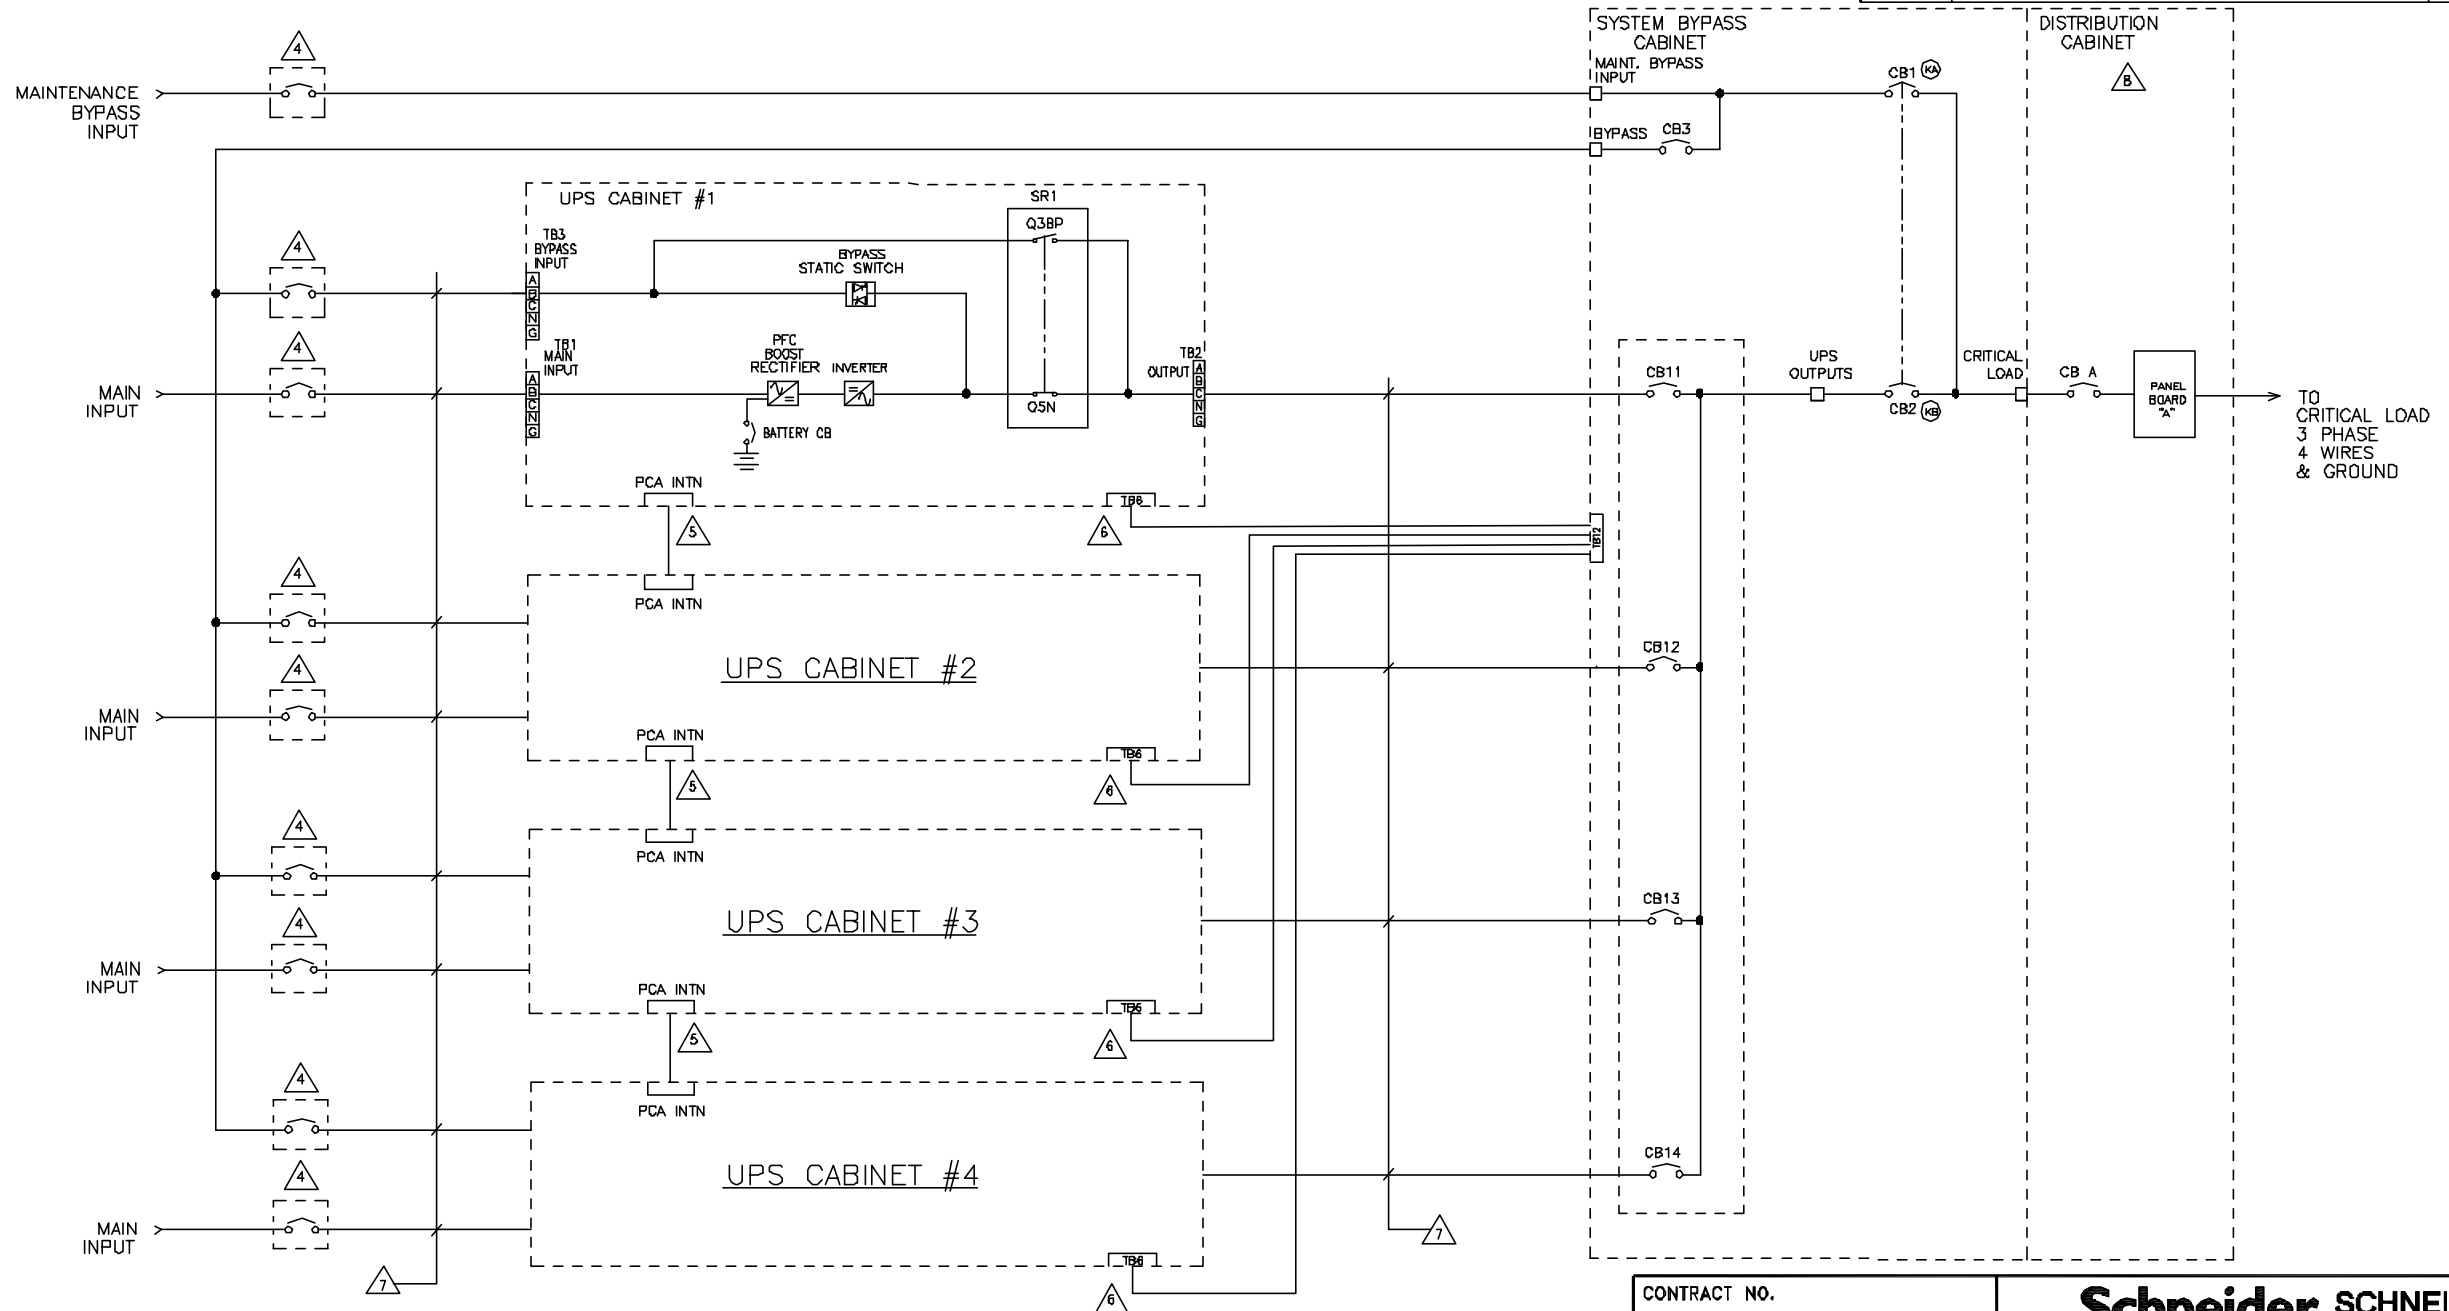

1. FOLLOW ALL APPLICABLE NEC AND LOCAL ELECTRICAL CODES.
 2. ALL EXTERNAL WIRING BY CUSTOMER.
 3. POWER AND CONTROL CABLES SHALL BE IN SEPARATE CONDUITS.
 - ⚠️ UPSTREAM PROTECTIVE DEVICE REQUIRED. PROVIDED BY CUSTOMER. 3 PHASE, 4 WIRES & GROUND PER UNIT.
 - ⚠️ REFERENCE SHEET 2.
 - ⚠️ CABLES SUPPLIED BY CUSTOMER. REFERENCE DRAWING 90-170823-00 FOR BREAKER AUX CONTACT CONNECTIONS.
 - ⚠️ CABLE SIZES AND LENGTHS FROM THE BYPASS AC SOURCE TO EACH UPS AND FROM EACH UPS OUTPUT TO THE SBC MUST BE IDENTICAL.
 - ⚠️ OPTIONAL, UP TO TWO CABINETS AVAILABLE. REFERENCE DRAWING 90-170824-00.
- NOTES: UNLESS OTHERWISE SPECIFIED.

CONTRACT NO.		SCHNEIDER ELECTRIC Critical Power & Cooling Service Division 1660 Scenic Avenue Costa Mesa, CA. 92626 U.S.A.	
APPROVALS	DATE		
DRAWN	B.KHOLOUSI	09-14-06	SINGLE LINE 4UPS DUAL INPUT 3CB SBC GALAXY 3000 PARALLEL
CHECKED	M.M.	09-14-06	
ISSUED	I.K.	09-14-06	
DO NOT SCALE DRAWING		SIZE B CAGE CODE 9L985 DWG NO. 90-170843-00 REV. B00	SCALE NONE CAD SHEET 1 OF 2

INTERCONNECTIONS BETWEEN UPS UNITS
EXCHANGE CURRENT AND CAN BUS
INTERCONNECTIONS BETWEEN UPS UNITS TO SBC

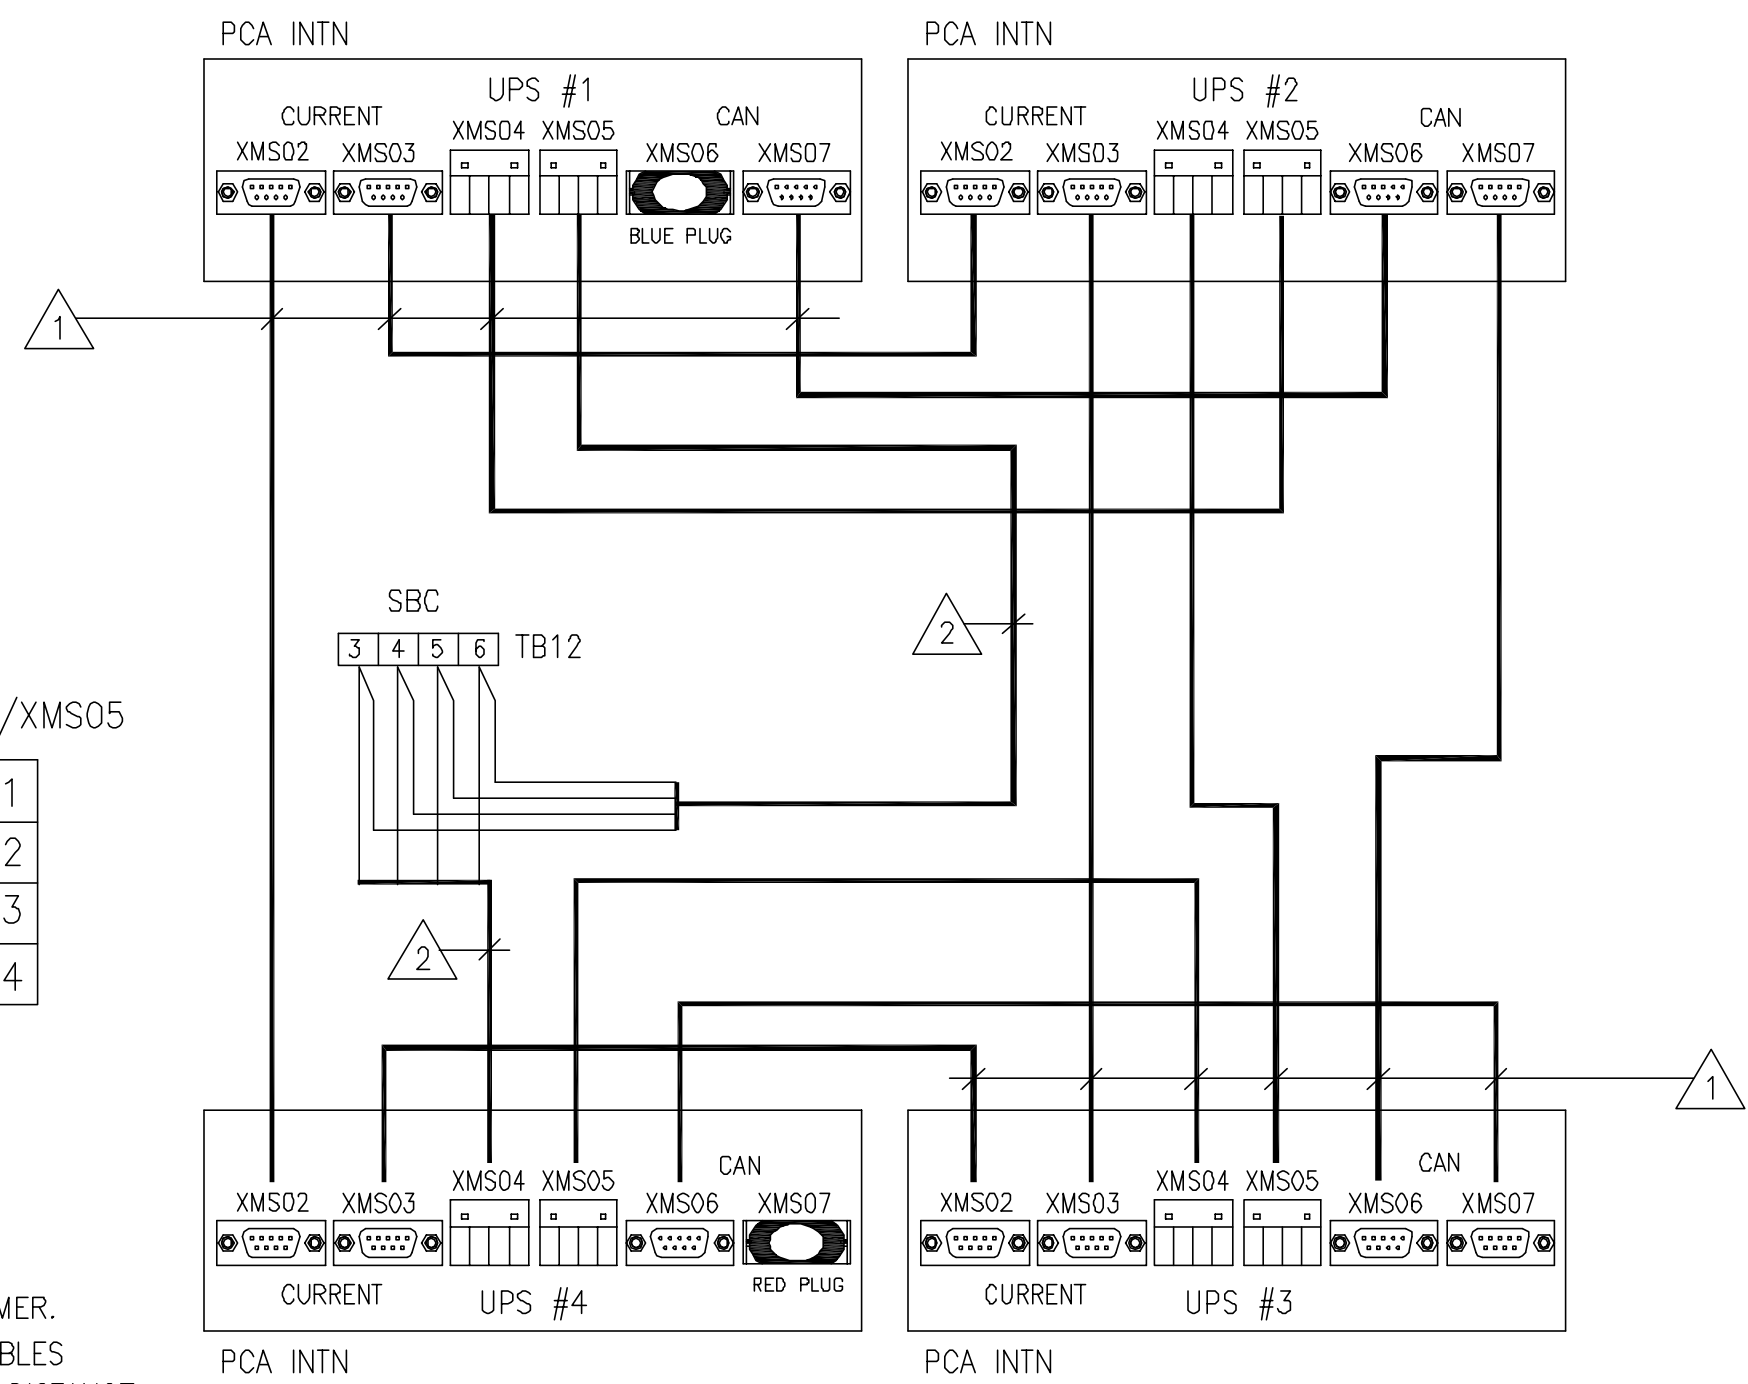

2 CABLES SUPPLIED BY CUSTOMER.
 1 THE SCHNEIDER ELECTRIC CABLES SUPPLIED (33 FT) LIMIT THE DISTANCE BETWEEN THE UPS UNITS.

NOTES: