



DO NOT STAND ON TOP OF CABINETS

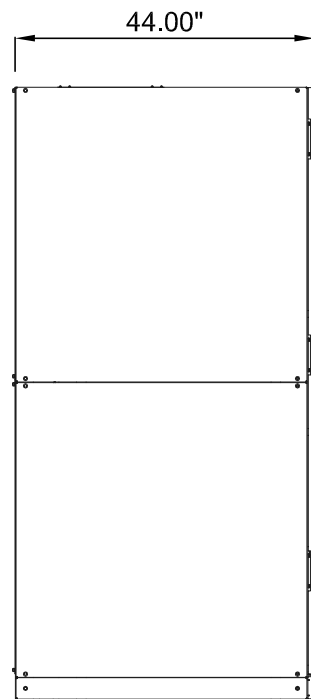

LEFT SIDE VIEW

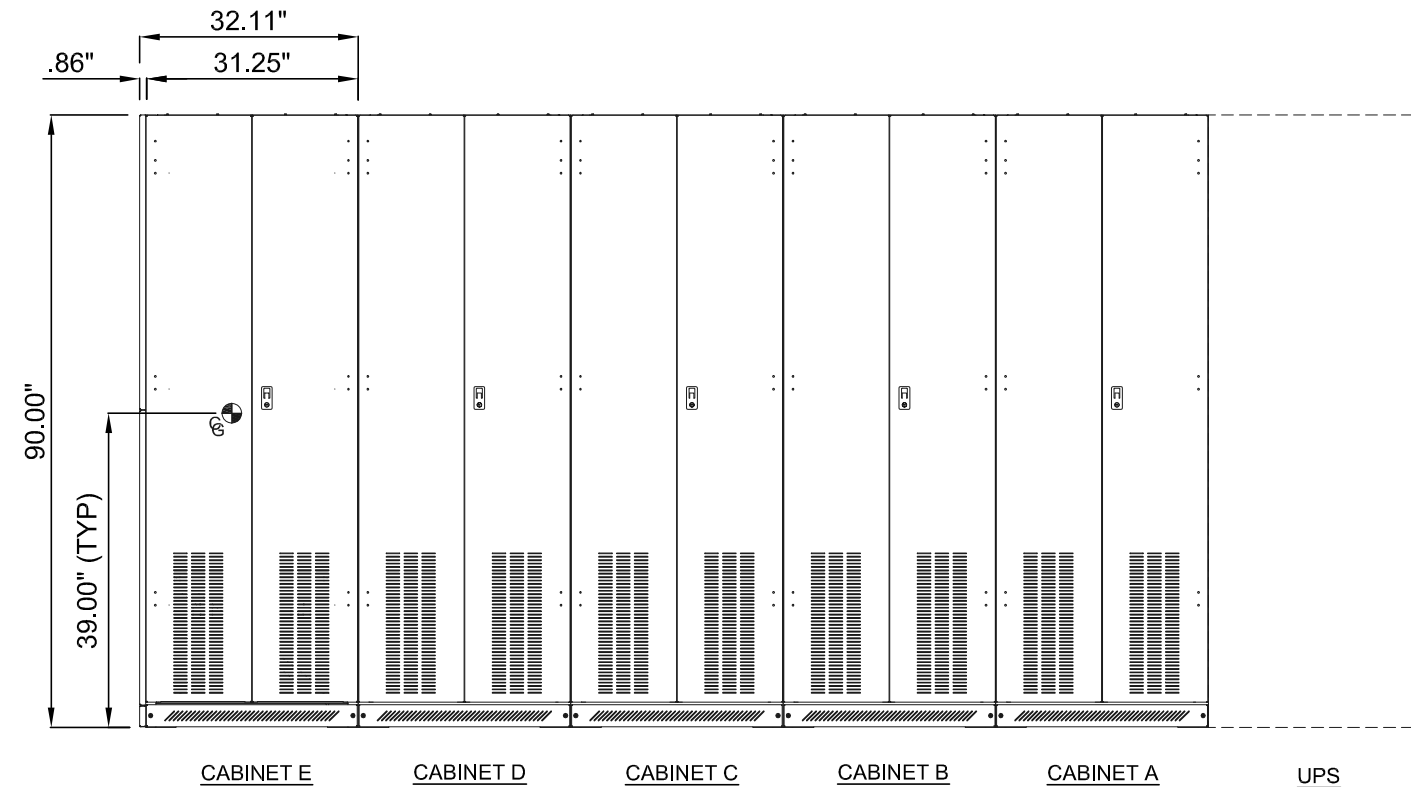

BATTERY CABINET SYSTEM LINEUP

FRONT VIEW

STEPS FOR BATTERY CABINET INSTALLATION PROCEDURE

1. RECOMMEND INSTALLING THE UPS FIRST IN ITS FINAL LOCATION. (REFER TO MGE INSTALLATION MANUAL AND INSTALLATION DRAWINGS).
2. TO HELP PREVENT DAMAGE, ALL PANELS FROM ALL BATTERY CABINETS SHOULD BE REMOVED AND PUT ASIDE IN A SAFE LOCATION WHILE MOVING THE CABINETS TO FINAL INSTALL POSITION.
3. INSTALL THE FIRST CABINET AS CLOSE AS POSSIBLE TO THE LEFT SIDE OF THE UPS THEN ADJACENT TO EACH OTHER. STARTING FROM THE RIGHT AND WORKING TO THE LEFT, THE BATTERY CABINETS SHOULD BE BOLTED TOGETHER.
4. ROUTE THE POWER CABLES AS SHOWN ON SHEET 5 OF 7.
5. INSTALL SIDE PANEL ONTO THE LEFT SIDE OF FAR LEFT BATTERY CABINET (LAST CABINET ON LEFT IN SERIES).
6. THE CABINET MUST BE ANCHORED TO THE FLOOR FOR SEISMIC SENSITIVE AREAS. ANCHORING HARDWARE IS NOT INCLUDED. CONTACT INTRAPACK TO PURCHASE ANCHORING HARDWARE

CAUTION:

CABINETS HAVE HIGH CENTER OF GRAVITY. HANDLE WITH CARE.


CABINET SYSTEMS ARE HEAVY AND COULD WEIGH AS MUCH AS 5,500 LBS PER CABINET

CAUTION: HIGH VOLTAGE, RISK OF ELECTRICAL SHOCK

- FOLLOW ALL SAFETY PRECAUTIONS WHEN WORKING ON THIS SYSTEM
- ALWAYS WEAR PROPER SAFETY EQUIPMENT INCLUDING EYE PROTECTION

* AFTER REVIEWING THIS DRAWING, IF QUESTIONS REMAIN: CONTACT INTRAPACK.

MARKETING NO.		MGESM-20012V-480-5-5D-A-MECH-ILS	
DRAWING SIZE: B NOT TO SCALE		 10817 SANDEN DRIVE DALLAS, TX. 75238 PHONE: 214-348-7105 FAX: 214-348-7115 EMAIL: SALES@INTRAPACK.COM	
DRAWN BY	DATE	WWW.INTRAPACK.COM DESCRIPTION ADJACENT BATTERY CABINET	
DBC	12/23/08		
APPR.	DATE		
SHEET 1 OF 2		DRAWING NO. MGESM-20012V-480-5-5D-A-MECH-ILS	
		REV. 01	

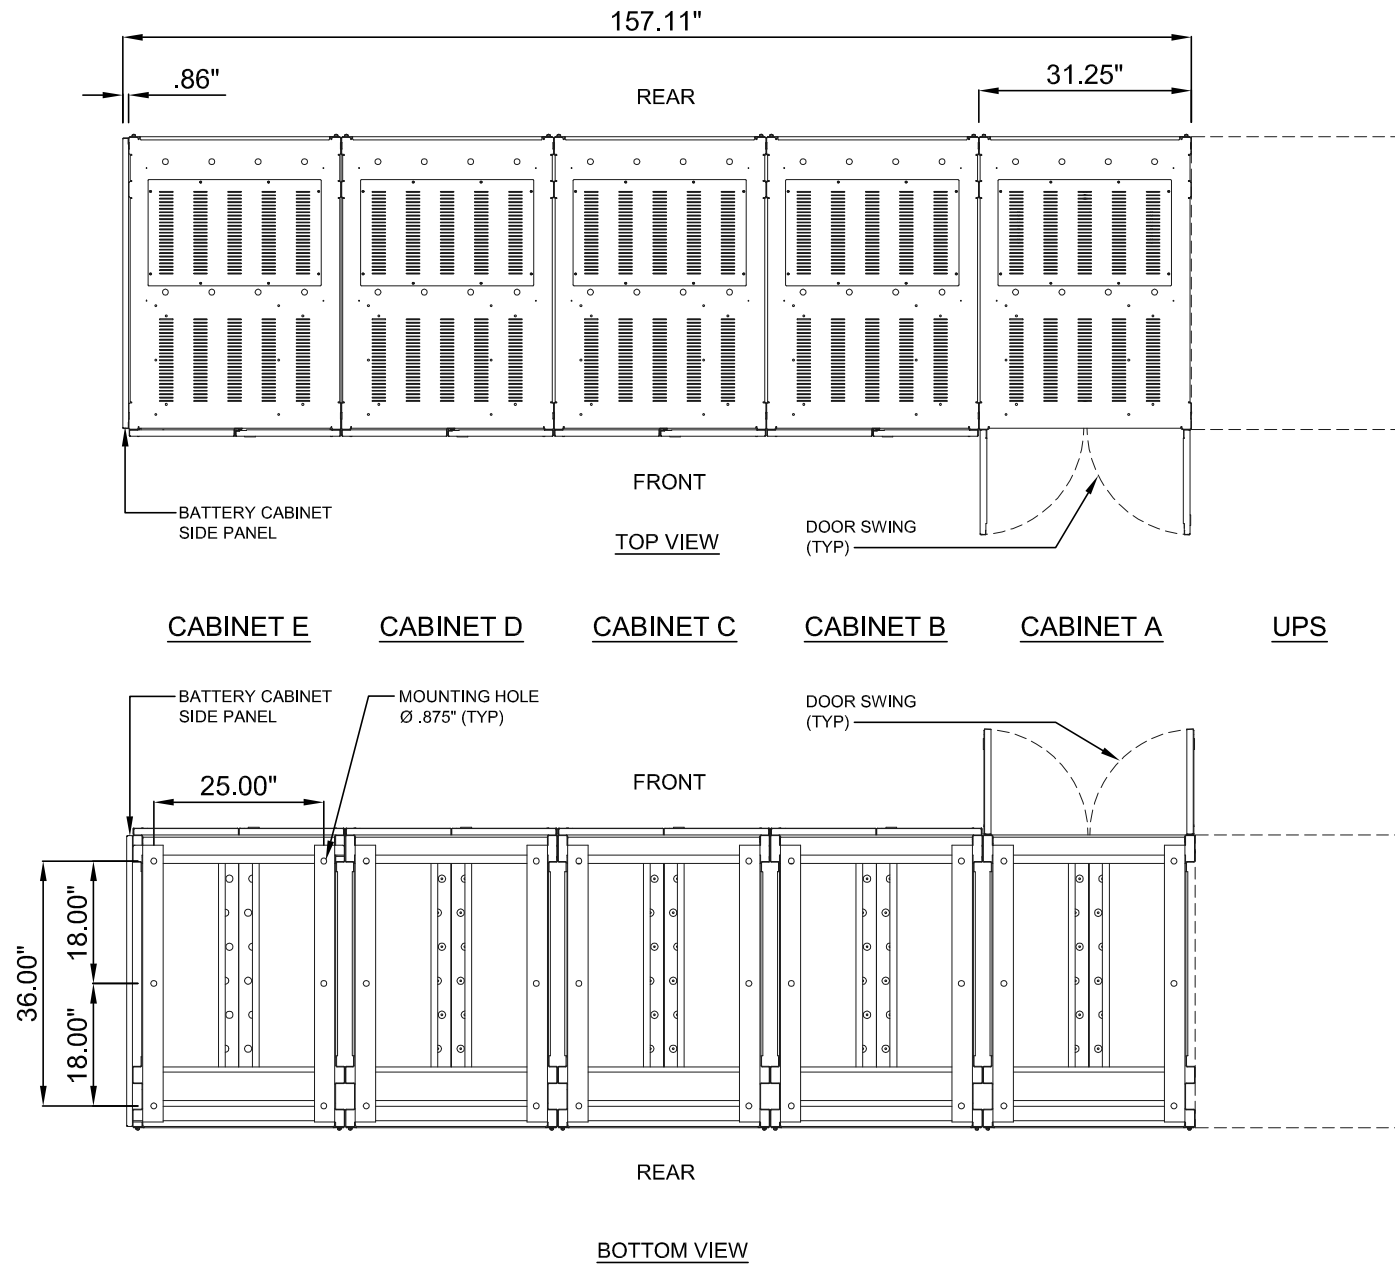

BATTERY CABINET SYSTEM LINEUP

CAUTION: HIGH VOLTAGE, RISK OF ELECTRICAL SHOCK

- FOLLOW ALL SAFETY PRECAUTIONS WHEN WORKING ON THIS SYSTEM
- ALWAYS WEAR PROPER SAFETY EQUIPMENT INCLUDING EYE PROTECTION

CAUTION:

CABINETS HAVE HIGH CENTER OF GRAVITY. HANDLE WITH CARE.

CABINET SYSTEMS ARE HEAVY AND COULD WEIGH AS MUCH AS 5,500 LBS PER CABINET

* AFTER REVIEWING THIS DRAWING, IF QUESTIONS REMAIN: CONTACT INTRAPACK.

MARKETING NO.		MGESM-20012V-480-5-5D-A-MECH-ILS	
DRAWING SIZE: B NOT TO SCALE		 10817 SANDEN DRIVE DALLAS, TX. 75238 PHONE: 214-348-7105 FAX: 214-348-7115 EMAIL: SALES@INTRAPACK.COM	
DRAWN BY	DATE	DESCRIPTION ADJACENT BATTERY CABINET	
DBC	12/23/08		
APPR.	DATE		
SHEET 2 OF 2		DRAWING NO. MGESM-20012V-480-5-5D-A-MECH-ILS	REV. 01