
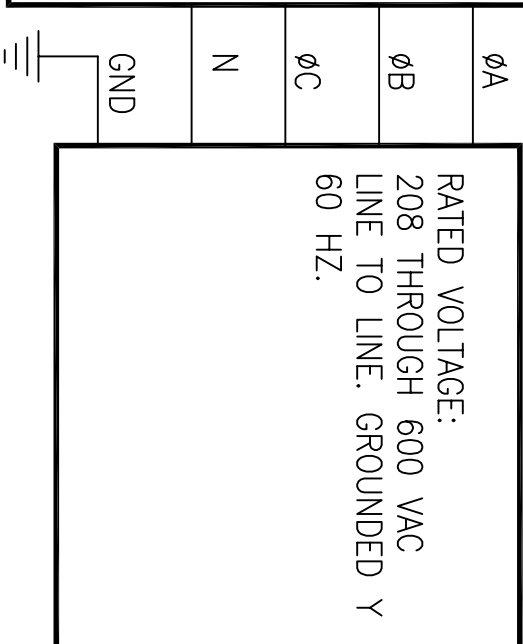


GENERAL DIAGRAM OF COMET INPUT SOURCE REQUIREMENT



ACCEPTABLE SOURCES
(WITH SOLIDLY GROUNDED NEUTRAL)

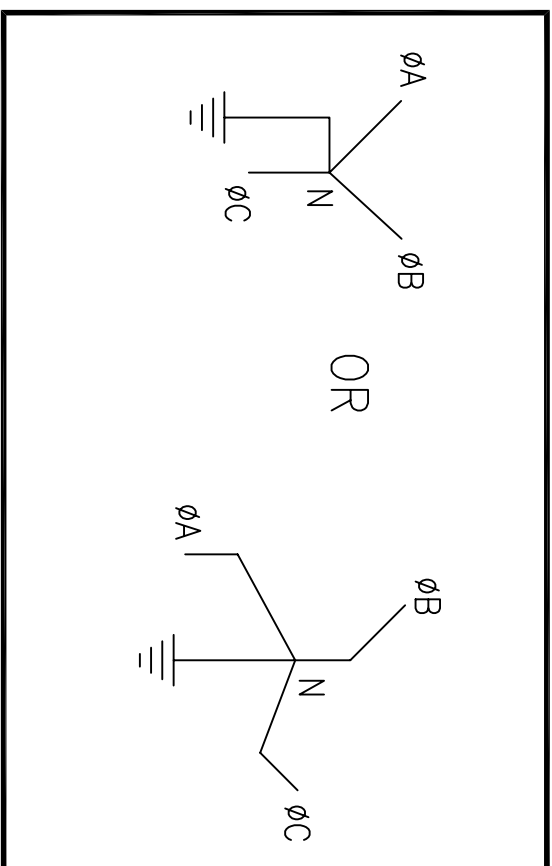



DISTRIBUTION BOARD

TRANSFORMER

COMET UPS (40-150 KVA)

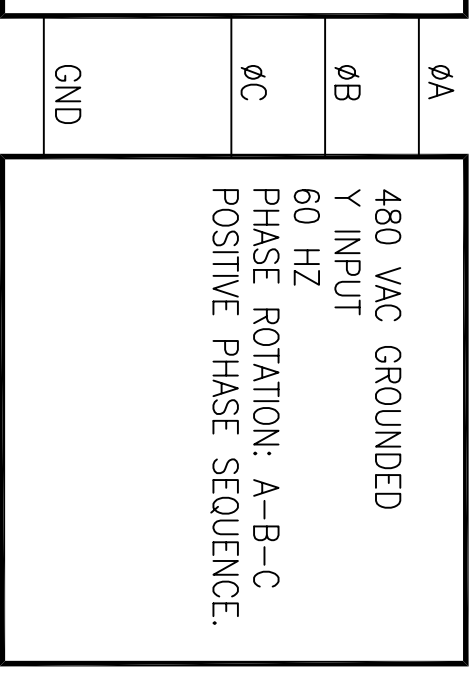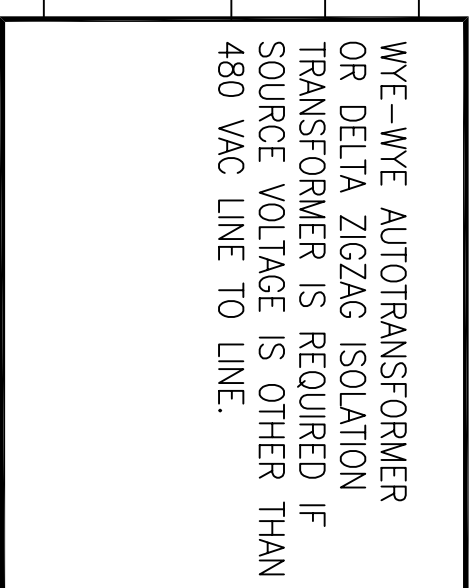



SOURCES THAT REQUIRE DELTA-WYE OR
DELTA ZIGZAG ISOLATION TRANSFORMER
TO FEED COMET UPS

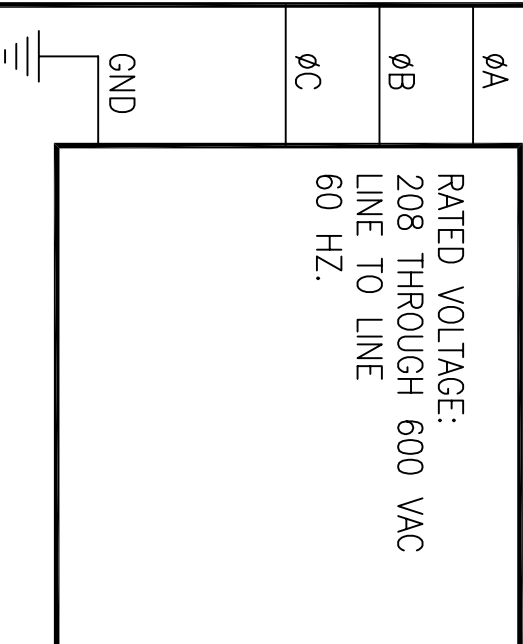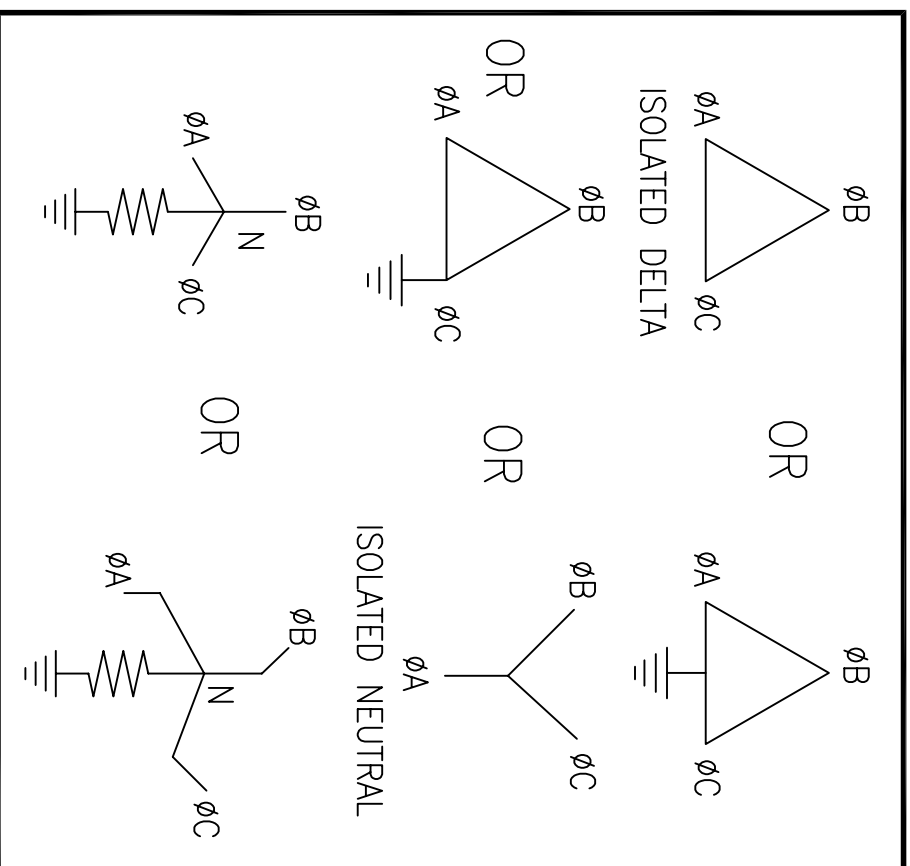

DISTRIBUTION BOARD

ISOLATION TRANSFORMER
DELTA-WYE OR DELTA-ZIGZAG

COMET UPS (40-150 KVA)

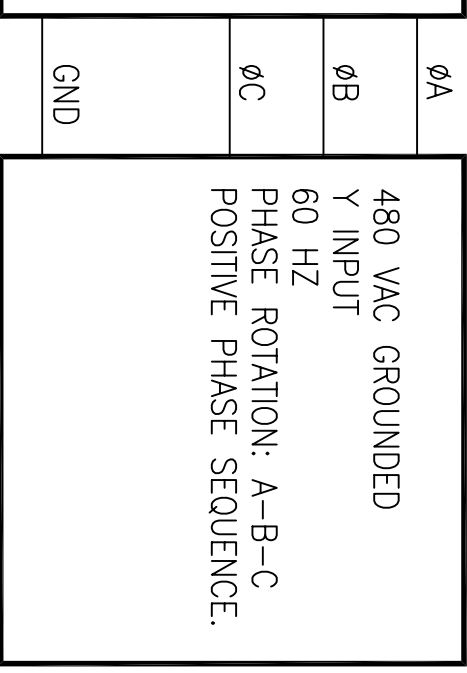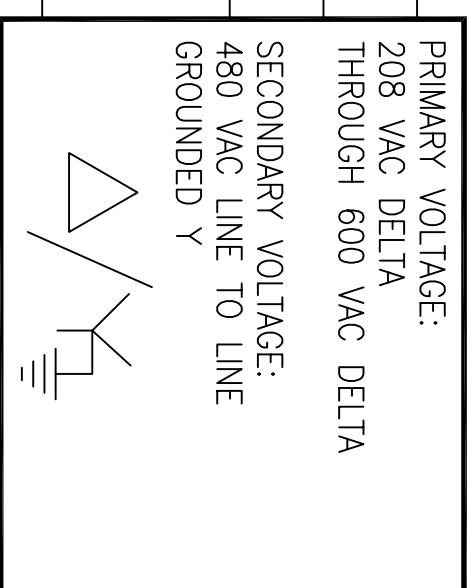

SIZE	CAGE CODE	DWG NO.	REV.
B	9L985	90-160080-00	E02
SCALE	NONE	CAD	SHEET 6 OF 7